





**VF WATER HEATER VWH (500-2000) - ONE WATER HEATER/HORIZONTAL  
STORAGE TANK RECOVERY SYSTEM (ONE TEMPERATURE)**

**WARNING:** THIS DRAWING SHOWS SUGGESTED  
PIPING CONFIGURATION AND OTHER DEVICES;  
CHECK WITH LOCAL CODES AND ORDINANCES  
FOR ADDITIONAL REQUIREMENTS.

ANY MATERIAL, COMPONENT OR VENDOR CHANGE  
MUST HAVE PRIOR APPROVAL BY THE APPLICABLE  
PRODUCT ENGINEERING DEPARTMENT.

**LEGEND**

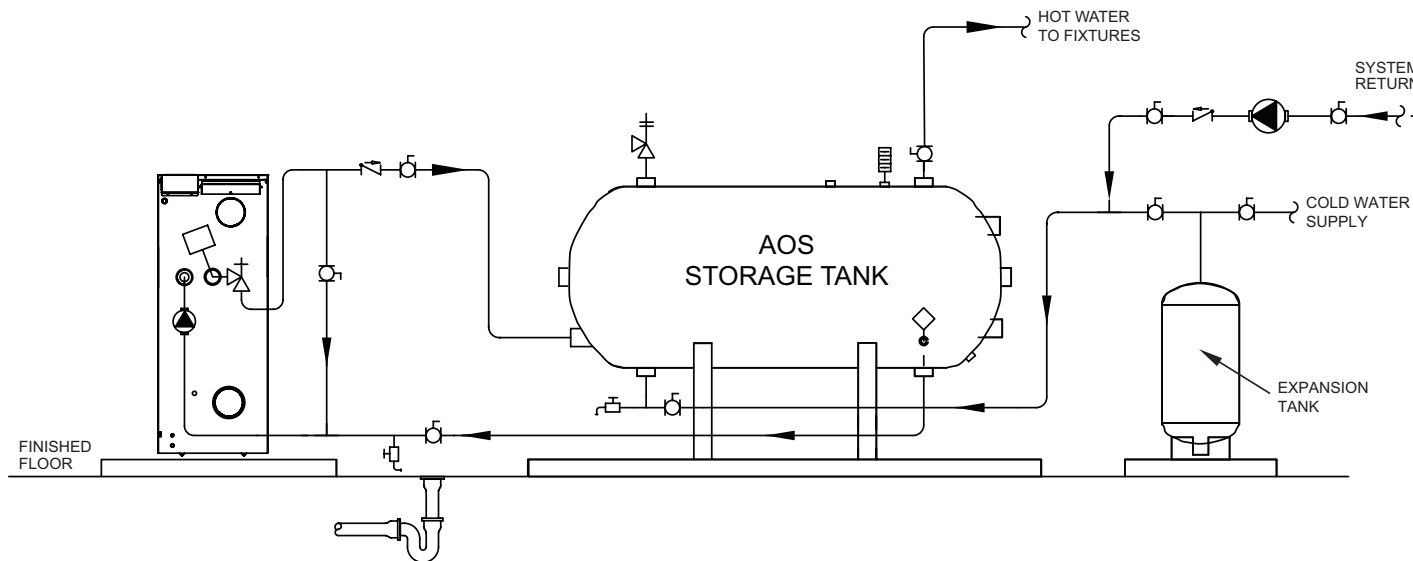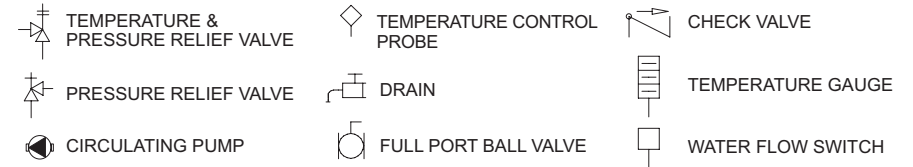

**NOTES:**

1. Preferred piping method.
2. The temperature and pressure relief valve setting shall not exceed pressure rating of any component in the system.
3. Service valves are shown for servicing water heater. However, local codes shall govern their usage.
4. Maximum piping length between tank and water heater should not exceed a total of 50 equivalent feet constructed of 2-1/2 inch pipe size or larger.