




**VF WATER HEATER VWH (500-2000) - ONE WATER HEATER/VERTICAL
STORAGE TANK RECOVERY SYSTEM (ONE TEMPERATURE)**

WARNING: THIS DRAWING SHOWS SUGGESTED
PIPING CONFIGURATION AND OTHER DEVICES;
CHECK WITH LOCAL CODES AND ORDINANCES
FOR ADDITIONAL REQUIREMENTS.

ANY MATERIAL, COMPONENT OR VENDOR CHANGE
MUST HAVE PRIOR APPROVAL BY THE APPLICABLE
PRODUCT ENGINEERING DEPARTMENT.

LEGEND

	TEMPERATURE & PRESSURE RELIEF VALVE		TEMPERATURE CONTROL PROBE		CHECK VALVE
	PRESSURE RELIEF VALVE		DRAIN		TEMPERATURE GAUGE
	CIRCULATING PUMP		FULL PORT BALL VALVE		WATER FLOW SWITCH

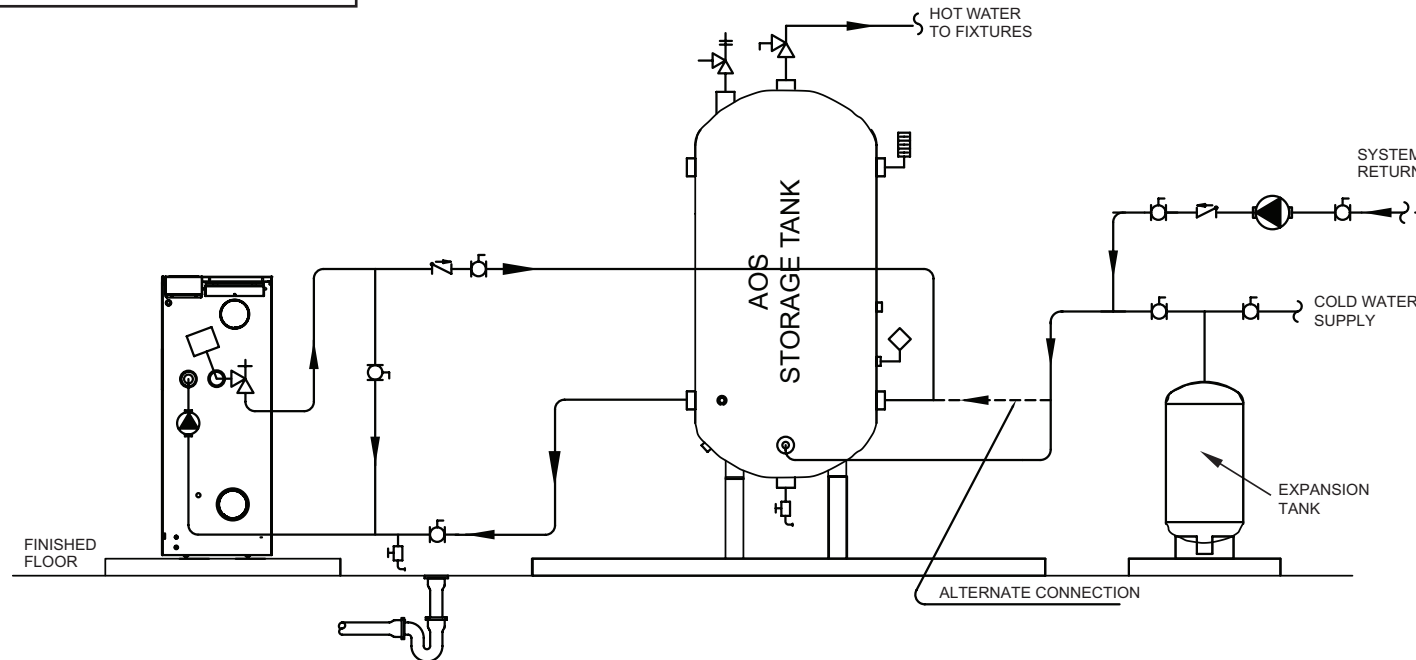

NOTES:

1. Preferred piping method.
2. The temperature and pressure relief valve setting shall not exceed pressure rating of any component in the system.
3. Service valves are shown for servicing water heater. However, local codes shall govern their usage.
4. Maximum piping length between tank and water heater should not exceed a total of 50 equivalent feet constructed of 2-1/2 inch pipe size or larger.